

**PROJECT NUMBER:** 30160-08-91108  
**PAGE:** 1 of 6  
**DATE:** January 7, 2008

662 Cromwell Avenue Telephone : (651) 645-3601  
Saint Paul, MN 55114 Toll Free : (888) 645-TEST  
USA Telefax : (651) 659-7348  
Website : www.storksmt.com

Investigative Chemistry Geotechnical Construction Materials  
Non Destructive Testing Failure Analysis Product Evaluation  
Metallurgical Analysis Materials Testing Welder Qualification

**SOUND TRANSMISSION AND SOUND ABSORPTION TESTING  
CONDUCTED ON AN ACOUSTICAL PANEL**

**Prepared for:**  
**CK WEGNER**  
**Attn: Mr. Clayton Wegner**  
**4212 Naber Avenue NE**  
**Saint Michael, MN 55376**

**Client Purchase Order Number: Credit Card Payment**

**Prepared By:**




**Mathew N. Botz**  
**Project Manager**  
**Product Testing Department**  
**(651) 659-7353**

**Reviewed By:**



**Kyle T. Hall**  
**Sr. Engineering Technician**  
**Product Testing Department**

**The test results contained in this report pertain only to the samples submitted for testing and not necessarily to all similar products.**



**SOUND TRANSMISSION (STC) –ASTM E90-04  
SOUND ABSORPTION (NRC)-ASTM C423-07**

**INTRODUCTION:**

This report presents the results of sound transmission and sound absorption testing conducted on an Acoustical Panel. The test sample was submitted by Mr. Clayton Wegner of CK Wegner. This work was completed on January 7, 2008.

This report must not be reproduced except in full with the approval of Stork Twin City Testing Corporation. The data in this report relates only to the items tested.

Stork Twin City Testing Corporation has been accredited by the U.S. Department of Commerce and the National Institute of Standards and Technology (NIST, formerly NBS) under their National Voluntary Laboratory Accreditation Program (NVLAP) for conducting ASTM E90 & C423 test procedures. This report may not be used to claim product endorsement by NVLAP, NIST or any agency of the U.S. Government.

**TEST RESULTS SUMMARY:**

<i>ASTM C423</i>				<b>Test Results</b>		
<b>Test #</b>	<b>Panel Identification</b>	<b>Weight (lbs)</b>	<b>Weight (psf)</b>	<b>NRC</b>	<b>SAA</b>	<b>--</b>
1	Acoustical Panel	108	3.0	<b>0.10</b>	<b>0.09</b>	--

<i>ASTM E90</i>				<b>Test Results</b>		
<b>Test #</b>	<b>Panel Identification</b>	<b>Weight (lbs)</b>	<b>Weight (psf)</b>	<b>STC</b>	<b>Def.</b>	<b>OITC</b>
2	Acoustical Panel	108	3.0	<b>28</b>	<b>32</b>	<b>24</b>

Tabular and graphical presentations of the data are presented under “TEST RESULTS” below.

**SPECIMEN DESCRIPTION:** (Also see "Test Results")

The test specimen was identified as an Acoustical Panel, with wood skins and a convex shape. The panel dimensions were 108” x 47-3/4” x 1-7/8” and weighed 108-lbs (3.0 psf).



Information and statements in this report are derived from material, information and/or specifications furnished by the client and exclude any expressed or implied warranties as to the fitness of the material tested or analyzed for any particular purpose or use. This report is the confidential property of our client and may not be used for advertising purposes. This report shall not be reproduced except in full, without written approval of this laboratory. The recording of false, fictitious or fraudulent statements or entries on this document may be punished as a felony under Federal Statutes including Federal Law Title 18, Chapter 47

PROJECT NUMBER: 30160-08-91108

PAGE: 3 of 6

DATE: January 7, 2008

**TEST PROCEDURE:****Sound Transmission Test**

ASTM:E90(04), "Laboratory Measurement of Airborne Sound Transmission of Building Partitions," was followed in every respect. The STC value was obtained by applying the Transmission Loss (TL) values to the STC reference contour of ASTM: E413(04), "Determination of Sound Transmission Class." The actual transmission loss at each frequency was calculated by the following equations:

$$TL = NR + 10 \log S - 10 \log A_2$$

where: TL = Transmission Loss (dB)  
NR = Noise Reduction (dB)  
S = Surface area common to both sides (sq. ft.)  
A<sub>2</sub> = Sound absorption of the receiving room with the sample in place (sabins)

**OITC Procedure**

ASTM:E1332(03), "Determination of Outdoor-Indoor Transmission Class", was followed in every respect. Basically, the OITC was calculated by using the sound transmission loss values in the 80 to 4000 Hz range as measured in accordance with ASTM E-90(04). These transmission loss data are then used to determine the A-weighted sound level reduction of the specimen for the reference source spectrum specified in Table 1 of ASTM E1332(03). The appropriate calculations were made to determine the OITC value. The source room has a volume of 2948-ft<sup>3</sup> (83-m<sup>3</sup>) and the termination room has a volume of 5825-ft<sup>3</sup> (165-m<sup>3</sup>).

The temperatures and relative humidity of the termination room met the requirements of the standard during and after the test. All frequencies met the requirements for 95% confidence established by the standard.

**Sound Absorption Test**

ASTM C 423-07," Sound Absorption and Sound Absorption Coefficient by the Reverberation Room Method", was followed in every respect. Two (2) panels were tested on the test chamber surface (Type A) with the convex side exposed to the noise. The panel ends were capped with 5/8" sheetrock to seal off the back side of the panel.

Noise Reduction Coefficient (NRC) was calculated by rounding the sound absorption coefficients for 250, 500, 1000 and 2000 Hz to the nearest 0.05. SAA was calculated by rounding the sound absorption coefficients for the twelve frequencies from 200 Hz to 2500 Hz to the nearest 0.01.

**PROJECT NUMBER:** 30160-08-91108**PAGE:** 4 of 6**DATE:** January 7, 2008**TEST EQUIPMENT:**

<u>Manufacturer</u>	<u>Model</u>	<u>Description</u>	<u>S/N</u>
Norwegian Electronics	NE830	Real Time Analyzer	11511
Brüel & Kjær	3923	Rotating Microphone Boom	815424
Norsonic (Source Rm)	1230	Pressure Condenser Microphone	26361
Brüel & Kjær (Term Rm)	4192	Pressure Condenser Microphone	2360314

**REMARKS:**


The test sample will be retained for a period of **15-days** and then discarded unless notified by the client.

F:\Product\MMFILES\MNB\2008 REPORTS MNB\91108-CK Wegner.doc

**TEST RESULTS:**

Filename <b>test #1</b>		<b><i>ASTM C423 - Sound Absorption</i></b>			
Client <b>C K Wegner</b>	Product <b>Acoustic Panels</b>	Model # <b></b>	Quantity <b>1</b>	Comment <b></b>	
Sample Size - Wt. <b>108.0 in x 95.4 in x 1-7/8" - 216 lbs</b>	Sample Description <b>C K Wagmer: 2-Acoustic Panels: : Panel Size: 108"x 47-3/4"x 1-7/8"per panel, (2) Panels 108"x 95.4" :</b>				
Time Stamp <b>Mon, Dec 10, 2007 - 10:26 AM</b>	Total Sample Area <b>71.6 ft<sup>2</sup></b>				

F (Hz)	Absorption Coefficient	Absorption (Sabins)*
100	0.22	16.00
125	0.09	6.39
160	0.09	6.42
200	0.08	5.79
250	0.15	10.92
315	0.11	7.54
400	0.10	6.99
500	0.09	6.21
630	0.08	6.07
800	0.08	6.05
1000	0.08	5.49
1250	0.08	5.50
1600	0.08	5.40
2000	0.09	6.21
2500	0.08	5.84
3150	0.08	5.59
4000	0.11	8.12
5000	0.14	9.86

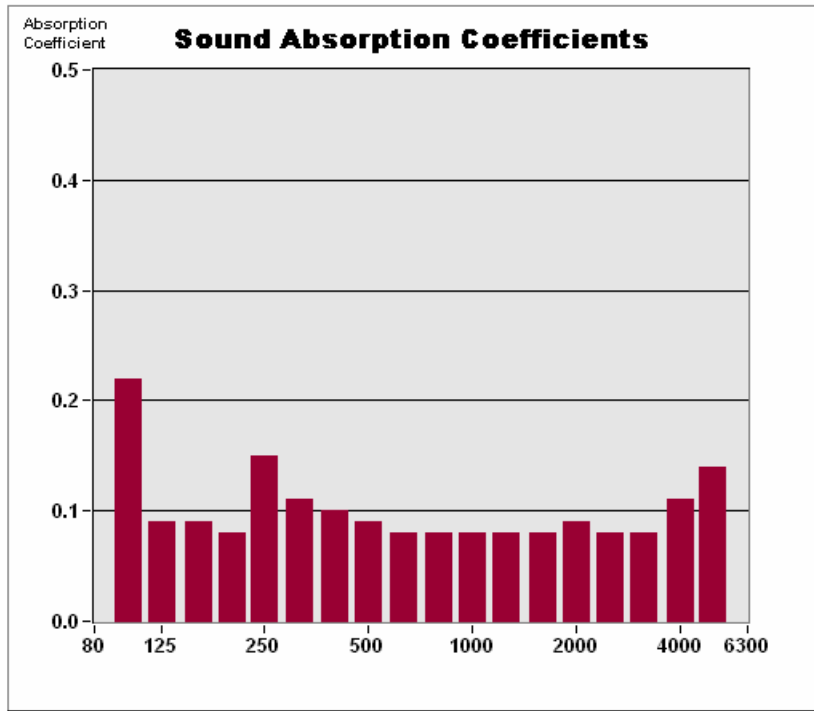

Temp (°C) **21.0** R.H. (%) **56** ATM (mbar) **1000**

**SAA = 0.09 NRC = 0.10**

\* total absorption based on 71.6 ft<sup>2</sup>

Information and statements in this report are derived from material, information and/or specifications furnished by the client and exclude any expressed or implied warranties as to the fitness of the material tested or analyzed for any particular purpose or use. This report is the confidential property of our client and may not be used for advertising purposes. This report shall not be reproduced except in full, without written approval of this laboratory. The recording of false, fictitious or fraudulent statements or entries on this document may be punished as a felony under Federal Statutes including Federal Law Title 18, Chapter 47

**TEST RESULTS:**

Filename

test #2

**ASTM E90 - Laboratory Sound Transmission Class**

Project Folder

91108 Wegner

Client

CK Wegner

Product

Acoustical Panel

Model #

Quantity

1

Comment

Sample Size - Wt.

75.1 in x 47.8 in x 1-7/8" - 74 lbs

Sample Description

CK Wegner

(1) Acoustical Panel :

75-1/8" x 47-3/4" (1) Acoustical Panel: :


Time Stamp

Mon, Jan 07, 2008 - 10:41 AM

TLs - sample TL values (dB)  
95% CI - 95% Confidence Interval (dB)  
def - STC deficiencies (dB)

F (Hz)	TLs	95% CI	def
80	16	3.3	-
100	15	2.4	-
125	23	2.7	0
160	21	3.0	0
200	21	2.6	0
250	21	2.6	0
315	22	2.5	2
400	24	2.3	3
500	25	1.8	3
630	26	1.7	3
800	26	1.4	4
1000	27	1.2	4
1250	28	1.0	4
1600	29	0.8	3
2000	29	0.6	3
2500	30	0.5	2
3150	31	0.4	1
4000	33	0.4	0

**dB Sound Transmission Class (STC)**

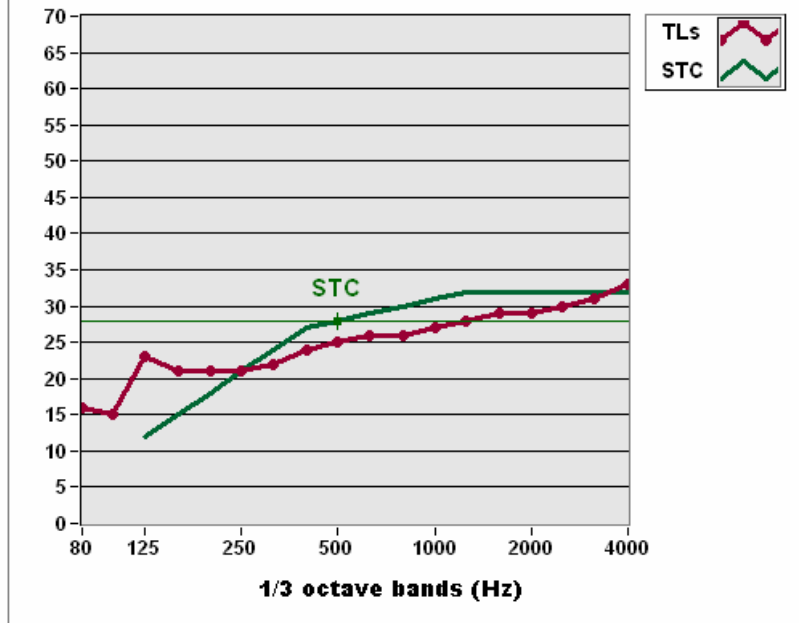

**STC = 28 def: 32  
OITC: 24**

Temp (°C)

20.4

R.H. (%)

52

ATM (mbar)

983

Information and statements in this report are derived from material, information and/or specifications furnished by the client and exclude any expressed or implied warranties as to the fitness of the material tested or analyzed for any particular purpose or use. This report is the confidential property of our client and may not be used for advertising purposes. This report shall not be reproduced except in full, without written approval of this laboratory. The recording of false, fictitious or fraudulent statements or entries on this document may be punished as a felony under Federal Statutes including Federal Law Title 18, Chapter 47